


LYE3125LDPW



ELECTROZEMPER S.A. Avda. de la Ciencia s/n. Parque Ind. Avanzado 13005 Ciudad Real. Spain. Tel.: +34 902 11 11 97 Fax: +34 902 11 11 97 in fo@zemper.com www.zemper.com

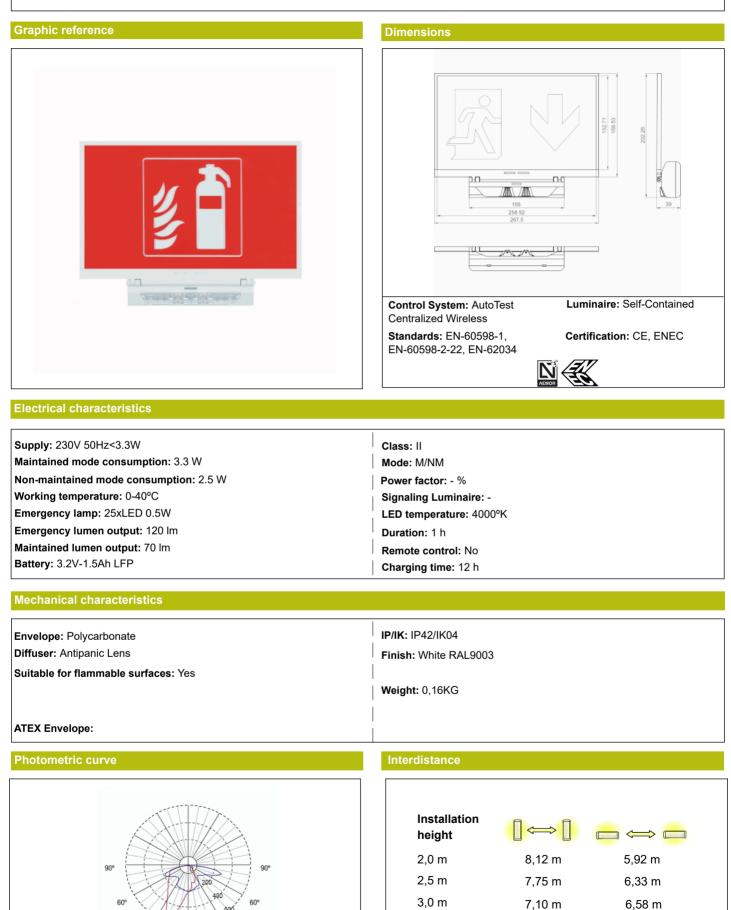

3,5 m

309

160

30

6,32 m

6,73 m



LYE3125LDPW



 $\begin{array}{l} \mbox{ElectroZEMPER S.A.} \\ \mbox{Avda. de la Ciencia s/n.} \\ \mbox{Parque Ind. Avanzado} \\ \mbox{13005 Ciudad Real. Spain.} \\ \mbox{rel. +34 902 11 11 97} \\ \mbox{Fax: +34 902 11 11 97} \\ \mbox{Fax: +34 902 11 11 97} \\ \mbox{rel. com} \\ \mbox{www.zemper.com} \end{array}$

Installation characteristics

Maintained luminaires use 4 terminals (2xL + 2xN). Luminaires have a selector bridge to enable / disable the maintained mode. (lens lighting). Installation with mounting plate. Possibility of installation in: Wall surface. Possibility of connection with: Surface tube wiring. Vision distance: 25 m

Operating characteristics

The luminaire has status LEDs, which indicates:
Status of the battery charging circuit.
Battery status (duration)
Emergency status function.
Test status.
Microprocessor controlled luminaire
The luminaire can be connected to a control unit.
When the luminaire is installed without a control unit, it performs periodic and automatic tests.
Functional test every 7 days.
Duration test every 365 days.
The test result is shown in the status indicator LEDs.
Wireless communication that allows: Communication with Control unit by wireless communication with a 868Mhz frequency system.

General Envelope data